

## HYDROCAL 1009 Offshore

Multi-Gas-in-Oil Analysis System with Transformer Monitoring Functions for Offshore Applications



The HYDROCAL 1009 Offshore is a permanently installed multi-gas-in-oil analysis system with transformer monitoring functions. It individually measures, Moisture in Oil (H<sub>2</sub>O) and the key gases Hydrogen (H<sub>2</sub>), Carbon Monoxide (CO), Carbon Dioxide (CO<sub>2</sub>), Methane (CH<sub>4</sub>), Acetylene (C<sub>2</sub>H<sub>2</sub>), Ethylene (C<sub>2</sub>H<sub>4</sub>), Ethane (C<sub>2</sub>H<sub>6</sub>) and Oxygen (O<sub>2</sub>) dissolved in transformer oil.

The HYDROCAL 1009 Offshore is specially designed for the harsh conditions (salt water, corrosion) on offshore platforms (e.g. offshore wind mill parks). A special painted housing with no window and the application of chrome nickel and stainless steel ensures the reliability and the persistence of the device.

The device can serve as a compact transformer monitoring system by the integration / connection of other sensors present on a transformer via its optional analog inputs:


- 4 Analog inputs 0/4 ... 20mADC
- 6 Analog inputs 0/4 ... 20mAAC +20% or 0 ... 80 VAC +20% (configurable by jumpers)

It is further equipped with digital outputs for the transmission of alarms or the execution of control functions (e.g. control of a cooling system of a transformer):

- 10 digital relay outputs
- 5 digital optocoupler outputs (option)

### Key Advantages

- Individual measurement of Hydrogen (H<sub>2</sub>), Carbon Monoxide (CO), Carbon Dioxide (CO<sub>2</sub>), Methane (CH<sub>4</sub>), Acetylene (C<sub>2</sub>H<sub>2</sub>), Ethylene (C<sub>2</sub>H<sub>4</sub>), Ethane (C<sub>2</sub>H<sub>6</sub>) and Oxygen (O<sub>2</sub>)
- Moisture in Oil (H<sub>2</sub>O) measurement
- Special design for offshore applications:
  - Housing without window painted in C5M
  - Back plate with cable glands (chrome-nickel steel, IP 68, corrosion-free and acid-resistant)
  - Back plate, oil entrance and housing screws made of stainless steel V4A
- Easy to mount on a transformer valve (G 1½" DIN ISO 228-1 or 1½" NPT ANSI B 1.20.1)
- Installation on the operational transformer without any operational interruption
- Advanced software (on the unit and via PC)
- Maintenance free system
- Communication interfaces ETHERNET 10/100 Mbit/s (copper-wired / RJ 45 or fibre-optical / SC Duplex) and RS 485 to support MODBUS<sup>®</sup>RTU/ASCII, MODBUS<sup>®</sup>TCP, DNP3 proprietary communication and IEC 61850 protocols
- Optional DNP3 software stack modem for SCADA connection
- Optional IEC 61850 software stack modem for SCADA connection
- Optional HV and LV bushing sensors for HV and LV bushing monitoring applications via communication interface



## Transformer monitoring functions

### Voltages and Currents

(via voltage and current transformers / transducer)

### Temperature Monitoring

Bottom and top oil temperature, ambient temperature  
(via additional temperature sensors)

### Cooling Stage / Tap Changer Position


(e.g. via current transducer)

### Free configuration

Analog inputs can be free allocated to any additional sensor

### Further Calculations:

Hot-Spot (acc. IEC 60076) } joint development  
Loss-of-Life } with PAUWELS  
Ageing Rate } Belgium

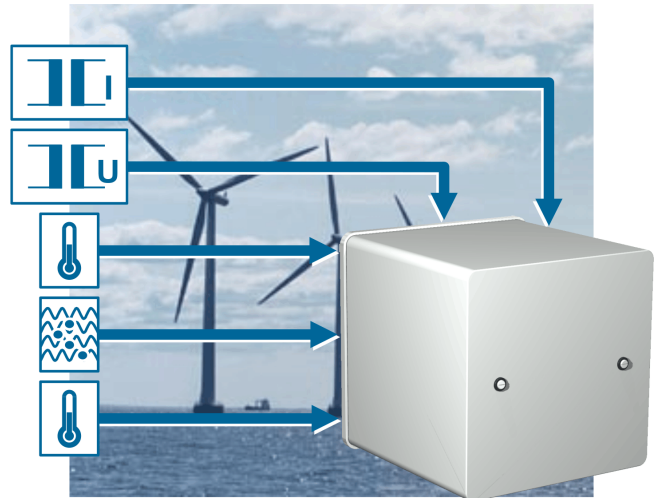

## HV and LV Bushing monitoring functions (option)

HYDROCAL BPD is a modular online monitoring system for high voltage bushings. It supports the measurement of voltage and phase angle on the test tap to derive  $\tan\delta$ /PF, bushing capacitance.



HYDROCAL BPD can be combined with other HYDROCAL models, preferably HYDROCAL genX, in order to set up a comprehensive monitoring system.

As per CIGRÉ Working Group A2.37 bushings resp. the lead exit represents the 2<sup>nd</sup> largest group of transformer failure locations (approx. 25%) after the windings (43%) and before the tap changers (23%). Therefore, bushing monitoring can help to reduce those failures. HYDROCAL BPD combined with online DGA performed by the HYDROCAL product family provides the ideal overall transformer monitoring solution.

The measurement of voltage and phase angle on the test tap of high voltage bushings allows to compare  $\tan\delta$ /PF with factory test results for analysing deterioration of the bushings.

### Key Advantages

- Monitoring of capacitance,  $\tan\phi$ /PF of up to six high voltage bushings (1 up to 6 bushings)
- Advanced software (on the unit and via PC) with intuitive operation by 7" color TFT capacitive touchscreen, WLAN and Webserver operation from any smart phone, tablet or notebook PC
- Communication interfaces WiFi, USB or ETHERNET 10/100 Mbit/s
- SD memory of test results, history and diagnostic data of power transformers
- Maintenance free system

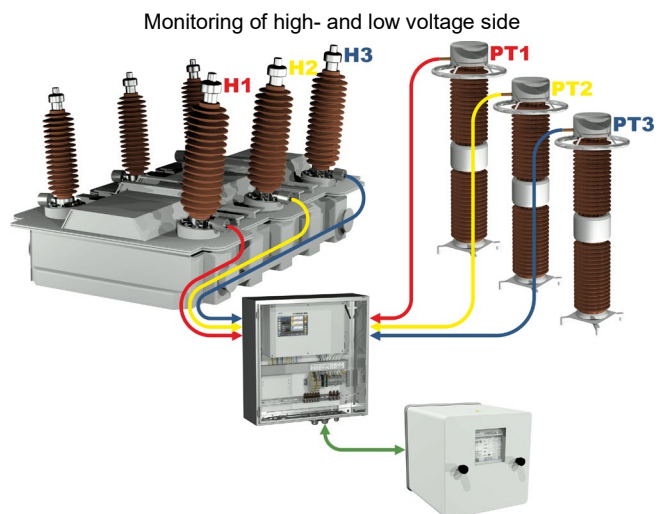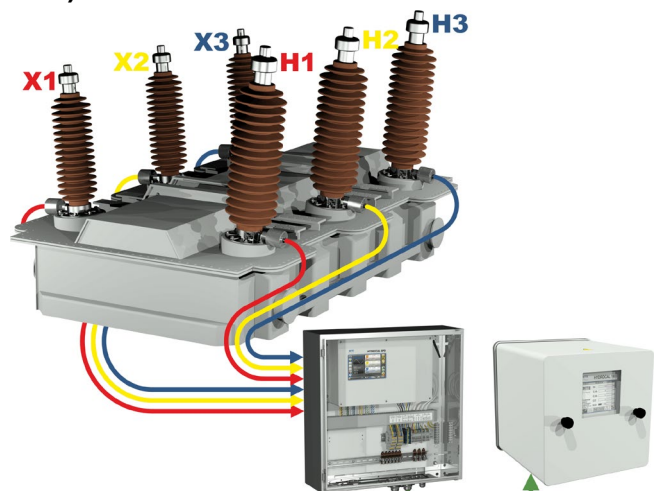


Reference CCVT / CCPT

## HYDROCAL firmware main menu

- 1 Extraction status**
  - Shows the actual operating status of the unit
- 2 Gas-in-oil overview**
  - Column chart
  - Trend graph
  - Data table
- 3 Transformer specific measurements**
  - Trend graph
  - Data table


(to be included)

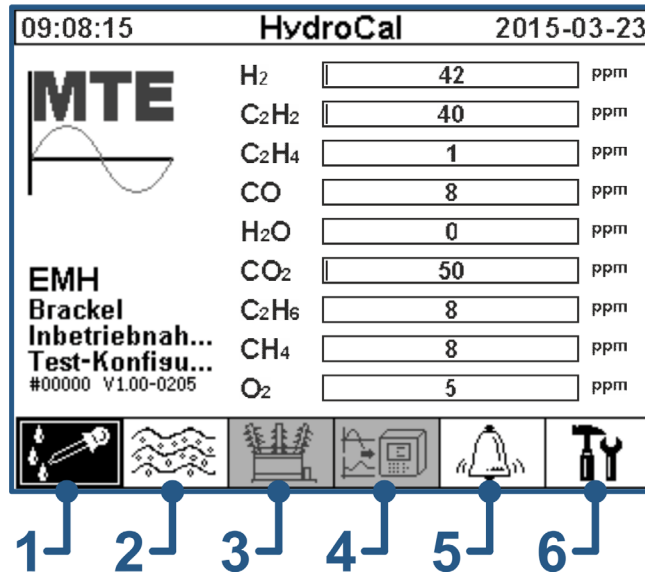

- 4 Additional sensor measurements**
  - Trend graph
  - Data table


(to be included)
- 5 Alert overview**
  - Alert acknowledgement
  - Alert table
- 6 Device setup**
  - Alert level setting
  - Communication setting
  - Transformer setting
  - In- and output setting

### Extraction status

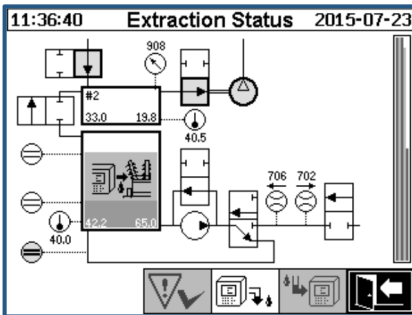

Shows the status of the actual process step and information of safety functions.

### Gas-in-oil overview

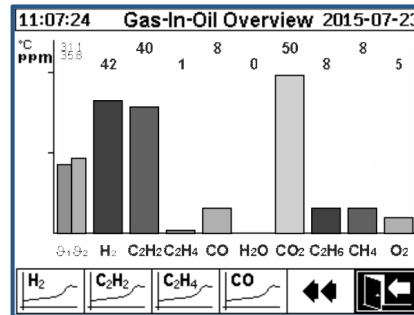

Individual chart diagram for Hydrogen (H<sub>2</sub>), Carbon Monoxide (CO), Carbon Dioxide (CO<sub>2</sub>), Methane (CH<sub>4</sub>), Acetylene (C<sub>2</sub>H<sub>2</sub>), Ethylene (C<sub>2</sub>H<sub>4</sub>), Ethane (C<sub>2</sub>H<sub>6</sub>), Oxygen (O<sub>2</sub>) and Moisture in Oil (H<sub>2</sub>O) and temperatures.

### Alert overview


#	Name	Date/Time	Status
1	H2-Alert	07-30 11:09	✓
2	CO-Alert	07-30 11:10	✓
3	CO2-Alert	07-30 11:10	✓
4	C2H2-Alert	07-30 11:12	✓
5	C2H4-Alert	07-30 11:12	✓
6	C2H6-Alert	07-30 11:13	✓
7	CH4-Alert	07-30 11:13	✓
8	O2-Alert	07-30 11:14	✓
9	H2O-Alert	07-30 11:14	✓

Display of alarm list. Details of each alarm and individual settings are shown.

## HydroSoft PC-Software

### Program key features

- Configuration and administration of each individual HYDROCAL unit
- Data and configuration read out of HYDROCAL units
- Processing and presentation of data read out (trend or table)
- Online functions (online sensors, extraction status and process flow)
- Diagnostic functions (Duval triangle and Rogers 3D graphic)
- Further processing of the processed data (Excel, CSV, clipboard and printing)
- Storage of the processed data and unit configuration
- Automatic data read out and alerting by e-mail

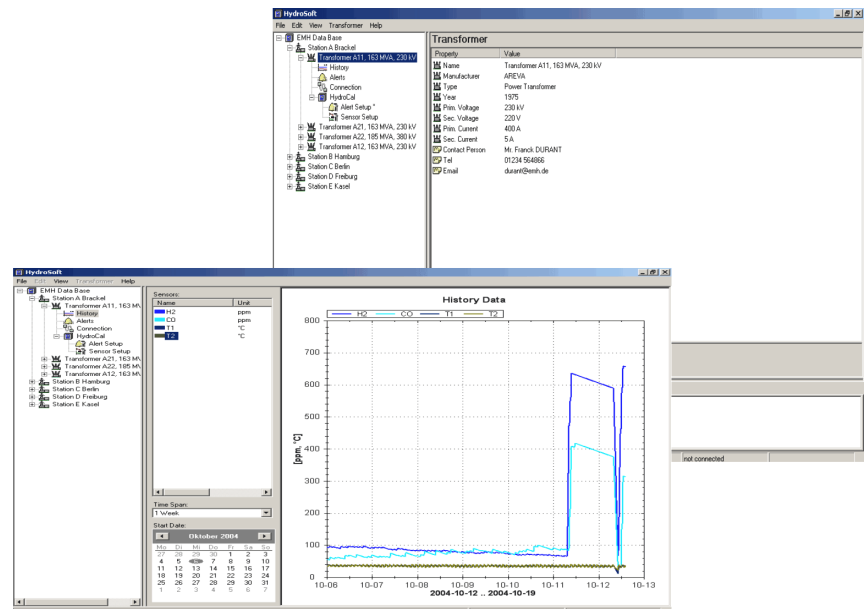

# Technical data HYDROCAL 1009 Offshore

## General

Optional nominal voltages of auxiliary supply:	120 V -20% +15% AC 50/60 Hz <sup>1)</sup> or 230 V -20% +15% AC 50/60 Hz <sup>1)</sup> or 120 V -20% +15% DC <sup>1)</sup> or 230 V -20% +15% DC <sup>1)</sup> Other nominal voltages on request!
Power consumption:	max. 600 VA
Housing:	Aluminium with painting C5M / stainless steel V4A
Dimensions:	W 263 x H 263 x D 327.5 mm
Weight:	approx. 18 kg
Operation temperature: (ambient)	-55°C ... +55°C (below -10°C display function locked)
Oil temperature: (in the transformer)	-20°C ... +90°C
Storage temperature: (ambient)	-20°C ... +65°C
Oil Pressure:	0 - 800 kpa (negative pressure allowed)
Connection to valve:	G 1½" DIN ISO 228-1 or 1½" NPT ANSI B 1.20.1

## Safety

Insulation protection:	IEC 61010-1
Degree of protection:	IP-55

## Measurements

Gas/Moisture in oil Measurement		Accuracy <sup>2) 3)</sup>
Measuring quantity	Range	
Hydrogen H <sub>2</sub>	0 ... 10.000 ppm	± 15 % ± 25 ppm
Carbon Monoxide CO	0 ... 10.000 ppm	± 20 % ± 25 ppm
Carbon Dioxide CO <sub>2</sub>	0 ... 20.000 ppm	± 20 % ± 25 ppm
Methane CH <sub>4</sub>	0 ... 5.000 ppm	± 20 % ± 25 ppm
Acetylene C <sub>2</sub> H <sub>2</sub>	0 ... 10.000 ppm	± 20 % ± 5 ppm
Ethylene C <sub>2</sub> H <sub>4</sub>	0 ... 10.000 ppm	± 20 % ± 10 ppm
Ethane C <sub>2</sub> H <sub>6</sub>	0 ... 10.000 ppm	± 20 % ± 15 ppm
Oxygen O <sub>2</sub>	0 ... 50.000 ppm	± 10 % ± 1000 ppm
Moisture H <sub>2</sub> O <sup>(aw)</sup>	0 ... 100 %	± 3 %
Moisture in Mineral Oil	0 ... 100 ppm	± 3 % ± 3 ppm
Moisture in synt. Ester <sup>5)</sup>	0 ... 2.000 ppm	± 3 % of MSC <sup>6)</sup>

<sup>5)</sup>Option <sup>6)</sup>Moisture Saturation Content

## Operation principle

- Miniaturized gas sample production based on headspace principle (no membrane, negative pressure proofed)
- Patent-pending oil sampling system (EP 1 950 560 A1)
- Near-infrared gas sensor unit for CO, C<sub>2</sub>H<sub>2</sub> and C<sub>2</sub>H<sub>4</sub>
- Near-infrared gas sensor unit for CO<sub>2</sub>, CH<sub>4</sub> and C<sub>2</sub>H<sub>6</sub>
- Micro-electronic gas sensor for H<sub>2</sub> and O<sub>2</sub>
- Thin-film capacitive moisture sensor H<sub>2</sub>O
- Temperature sensors (for oil and gas temperature)

## Connections



## Analog and digital outputs

10 x Analog DC outputs		Default concentration (Free assignment)
Type	Range	
1 x Current DC	0/4 ... 20 mADC	Hydrogen H <sub>2</sub>
1 x Current DC	0/4 ... 20 mADC	Carbon Monoxide CO
1 x Current DC	0/4 ... 20 mADC	Carbon Dioxide CO <sub>2</sub>
1 x Current DC	0/4 ... 20 mADC	Methane CH <sub>4</sub>
1 x Current DC	0/4 ... 20 mADC	Acetylene C <sub>2</sub> H <sub>2</sub>
1 x Current DC	0/4 ... 20 mADC	Ethylene C <sub>2</sub> H <sub>4</sub>
1 x Current DC	0/4 ... 20 mADC	Ethane C <sub>2</sub> H <sub>6</sub>
1 x Current DC	0/4 ... 20 mADC	Oxygen O <sub>2</sub>
1 x Current DC	0/4 ... 20 mADC	Moisture in Oil H <sub>2</sub> O
1 x Current DC	0/4 ... 20 mADC	Free programmable

10 x Digital outputs		Max. Switching capacity (Free assignment)
Type	Control voltage	
10 x Relay	12 VDC	220 VDC/VAC / 2 A / 60 W

## Analog inputs and digital outputs (option)

6 x Analog AC inputs		Accuracy	Remarks
Type	Range	of the measuring value	
6 x Current AC or 6 x Voltage AC	0/4 ... 20 mA +20% or 0 ... 80 V +20%	≤ 1.0 %	Configurable by jumpers <sup>4)</sup>

4 x Analog DC inputs		Accuracy	Remarks
Type	Range	of the measuring value	
4 x Current DC	0/4 ... 20 mADC	≤ 0.5 %	

5 x Digital outputs		Max. Switching capacity (Free assignment)
Type	Control Voltage	
5 x Optocoupler	5 VDC	U <sub>CE</sub> : 24 V rated / 35 V max. U <sub>EC</sub> : 7 V max. I <sub>CE</sub> : 40 mA max.

## Communication

- RS 485 (proprietary or MODBUS<sup>®</sup> RTU/ASCII protocol)
- ETHERNET 10/100 Mbit/s copper-wired / RJ 45 or fibre-optical / SC Duplex (proprietary or MODBUS<sup>®</sup> TCP protocol)
- DNP3 software stack modem (Option)
- IEC 61850 software stack modem (Option)

## Notes

- <sup>1)</sup> 120 V ⇔ 120 V -20% = 96 V<sub>min</sub>      120 V +15% = 138 V<sub>max</sub>  
230 V ⇔ 230 V -20% = 184 V<sub>min</sub>      230 V +15% = 264 V<sub>max</sub>
- <sup>2)</sup> Related to temperatures ambient +20°C and oil +55°C
- <sup>3)</sup> Accuracy for moisture in oil for mineral oil types
- <sup>4)</sup> Default jumper configuration: Current